

- DESIGN CRITERION: TRAFFIC INDEX SHALL BE 5.5.
- 2. STRUCTURAL SECTIONS SHALL BE DETERMINED BASED ON T.I. AND R-VALUES AS TABULATED IN THE STREET SECTIONS REQUIREMENTS STANDARD DRAWING.
- 3. ASPHALT CONCRETE SHALL BE TYPE A, WITH 3/4" AGGREGATE GRADATION AND PG 64-10 LIQUID ASPHALT BINDER PER CITY OF VISALIA STANDARD SPECIFICATIONS.
- 4. TACK COAT IS REQUIRED AND SHALL BE APPLIED PER CITY STANDARD SPECIFICATIONS.
- 5. ASPHALT CONCRETE REQUIREMENTS SHALL BE AS STATED IN THE CITY OF VISALIA STANDARD SPECIFICATIONS.
- ASPHALT CONCRETE SHALL BE PLACED ONLY WHEN THE ATMOSPHERIC TEMPERATURE IS 50° F AND RISING.
- 7. WITH ADDITIONAL LANDSCAPE EASEMENTS, SIDEWALK MAY BE LOCATED OUTSIDE RIGHT OF WAY TO PROVIDE ADDITIONAL PARKWAY.
- 8. A FOOTING EASEMENT WILL BE REQUIRED AS NEEDED FOR BLOCK WALL FOOTINGS THAT EXTEND INTO PRIVATE PROPERTY.
- 9. STREET TREES ARE REQUIRED IN ADDITION TO THE ON-SITE LANDSCAPE REQUIREMENT.
- 10. FOR PARTIAL WIDTH STREETS A MINIMUM OF 30 FT OF PAVEMENT AND 8 FT SHOULDERS ARE REQUIRED.
- 11. SOIL ADJACENT TO CONCRETE CURB AND SIDEWALK SHALL BE GRADED 3" BELOW TOP OF CURB TO ALLOW ROOM FOR MULCH.

APPROVED BY: CITY ENGINEER R.P.E. 81734 O9/16/16 DESIGN & IMPROVEMENT STANDARDS


REVISIONS

2 LANE LOCAL - RESIDENTIAL

09/15/16

BK 2016

P-1

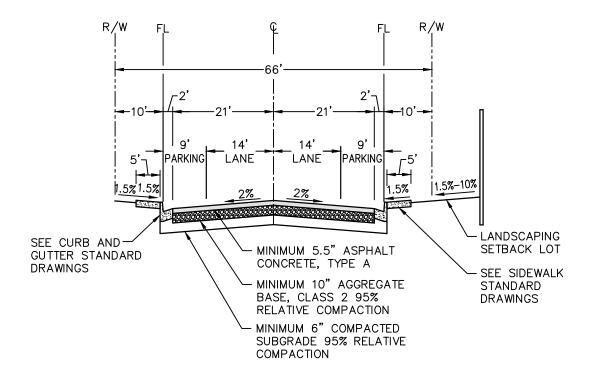

- 1. DESIGN CRITERION: TRAFFIC INDEX SHALL BE 9.
- 2. STRUCTURAL SECTIONS SHALL BE DETERMINED BASED ON T.I. AND R-VALUES AS TABULATED IN THE STREET SECTIONS REQUIREMENTS STANDARD DRAWING.
- ASPHALT CONCRETE SHALL BE TYPE A, WITH 3/4" AGGREGATE GRADATION AND PG 64-10 LIQUID ASPHALT BINDER PER CITY OF VISALIA STANDARD SPECIFICATIONS.
- 4. TACK COAT IS REQUIRED AND SHALL BE APPLIED PER CITY STANDARD SPECIFICATIONS.
- 5. ASPHALT CONCRETE REQUIREMENTS SHALL BE AS STATED IN THE CITY OF VISALIA STANDARD SPECIFICATIONS.
- 6. ASPHALT CONCRETE SHALL BE PLACED ONLY WHEN THE ATMOSPHERIC TEMPERATURE IS 50° F AND RISING.
- 7. WITH ADDITIONAL LANDSCAPE EASEMENTS, SIDEWALK MAY BE LOCATED OUTSIDE RIGHT OF WAY TO PROVIDE ADDITIONAL PARKWAY.
- 8. A FOOTING EASEMENT WILL BE REQUIRED AS NEEDED FOR BLOCK WALL FOOTINGS THAT EXTEND INTO PRIVATE PROPERTY.
- STREET TREES ARE REQUIRED IN ADDITION TO THE ON-SITE LANDSCAPE REQUIREMENT.
- 10. FOR PARTIAL WIDTH STREETS A MINIMUM OF 30 FT OF PAVEMENT AND 8 FT SHOULDERS ARE REQUIRED.
- 11. SOIL ADJACENT TO CONCRETE CURB AND SIDEWALK SHALL BE GRADED 3" BELOW TOP OF CURB TO ALLOW ROOM FOR MULCH.

APPROVED BY: CITY ENGINEER R.P.E. 81734 09/16/16 DATE DESIGN & IMPROVEMENT STANDARDS


REVISIONS

2 LANE LOCAL - INDUSTRIAL


09/15/16

BK 2016

P-Z

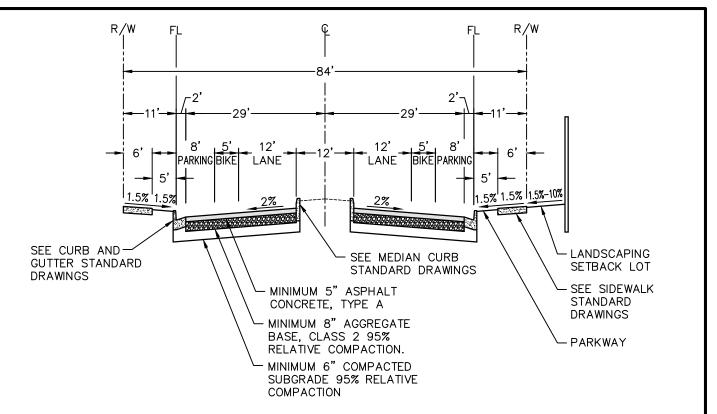

- 1. DESIGN CRITERION: TRAFFIC INDEX SHALL BE 8.
- 2. STRUCTURAL SECTIONS SHALL BE DETERMINED BASED ON T.I. AND R-VALUES AS TABULATED IN THE STREET SECTIONS REQUIREMENTS STANDARD DRAWING.
- 3. ASPHALT CONCRETE SHALL BE TYPE A, WITH 3/4" AGGREGATE GRADATION AND PG 64-10 LIQUID ASPHALT BINDER PER CITY OF VISALIA STANDARD SPECIFICATIONS.
- 4. TACK COAT IS REQUIRED AND SHALL BE APPLIED PER CITY STANDARD SPECIFICATIONS.
- ASPHALT CONCRETE REQUIREMENTS SHALL BE AS STATED IN THE CITY OF VISALIA STANDARD SPECIFICATIONS.
- 6. ASPHALT CONCRETE SHALL BE PLACED ONLY WHEN THE ATMOSPHERIC TEMPERATURE IS 50° F AND RISING.
- 7. WITH ADDITIONAL LANDSCAPE EASEMENTS, SIDEWALK MAY BE LOCATED OUTSIDE RIGHT OF WAY TO PROVIDE ADDITIONAL PARKWAY.
- A FOOTING EASEMENT WILL BE REQUIRED AS NEEDED FOR BLOCK WALL FOOTINGS THAT EXTEND INTO PRIVATE PROPERTY.
- 9. STREET TREES ARE REQUIRED IN ADDITION TO THE ON-SITE LANDSCAPE REQUIREMENT.
- 10. FOR PARTIAL WIDTH STREETS A MINIMUM OF 30 FT OF PAVEMENT AND 8 FT SHOULDERS ARE REQUIRED.
- 11. MEDIAN BREAK LOCATIONS AND U-TURN MOVEMENT LOCATIONS ARE SUBJECT TO APPROVAL OF THE CITY ENGINEER.
- 12. UNIMPROVED MEDIAN SHALL BE LEFT WITH NATIVE SOILS 3" BELOW THE TOP OF CURB.
- 13. SOIL ADJACENT TO CONCRETE CURB AND SIDEWALK SHALL BE GRADED 3" BELOW TOP OF CURB TO ALLOW ROOM FOR MULCH.

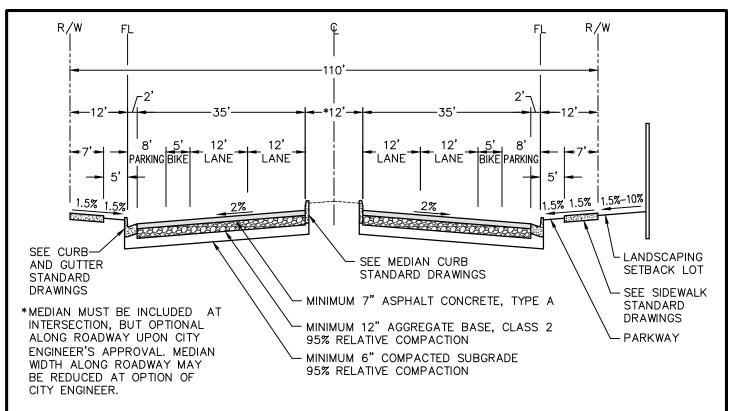


- 1. DESIGN CRITERION: TRAFFIC INDEX SHALL BE 11.
- 2. STRUCTURAL SECTIONS SHALL BE DETERMINED BASED ON T.I. AND R-VALUES AS TABULATED IN THE STREET SECTIONS REQUIREMENTS STANDARD DRAWING.
- 3. ASPHALT CONCRETE SHALL BE TYPE A, WITH 3/4" AGGREGATE GRADATION AND PG 64-10 LIQUID ASPHALT BINDER PER CITY OF VISALIA STANDARD SPECIFICATIONS.
- 4. TACK COAT IS REQUIRED AND SHALL BE APPLIED PER CITY STANDARD SPECIFICATIONS.
- ASPHALT CONCRETE REQUIREMENTS SHALL BE AS STATED IN THE CITY OF VISALIA STANDARD SPECIFICATIONS.
- 6. ASPHALT CONCRETE SHALL BE PLACED ONLY WHEN THE ATMOSPHERIC TEMPERATURE IS 50° F AND RISING.
- 7. WITH ADDITIONAL LANDSCAPE EASEMENTS, SIDEWALK MAY BE LOCATED OUTSIDE RIGHT OF WAY TO PROVIDE ADDITIONAL PARKWAY.
- 8. A FOOTING EASEMENT WILL BE REQUIRED AS NEEDED FOR BLOCK WALL FOOTINGS THAT EXTEND INTO PRIVATE PROPERTY.
- 9. STREET TREES ARE REQUIRED IN ADDITION TO THE ON-SITE LANDSCAPE REQUIREMENT.
- 10. FOR PARTIAL WIDTH STREETS A MINIMUM OF 30 FT OF PAVEMENT AND 8 FT SHOULDERS ARE REQUIRED.
- 11. MEDIAN BREAK LOCATIONS AND U-TURN MOVEMENT LOCATIONS ARE SUBJECT TO APPROVAL OF THE CITY ENGINEER.
- 12. UNIMPROVED MEDIAN SHALL BE LEFT WITH NATIVE SOILS 3" BELOW THE TOP OF CURB.
- 13. SOIL ADJACENT TO CONCRETE CURB AND SIDEWALK SHALL BE GRADED 3" BELOW TOP OF CURB TO ALLOW ROOM FOR MULCH.

APPROVED BY: CITY OF VISALIA DESIGN & IMPROVEMENT STANDARDS

4 LANE COLLECTOR

REVISIONS

09/15/16
BK 2016

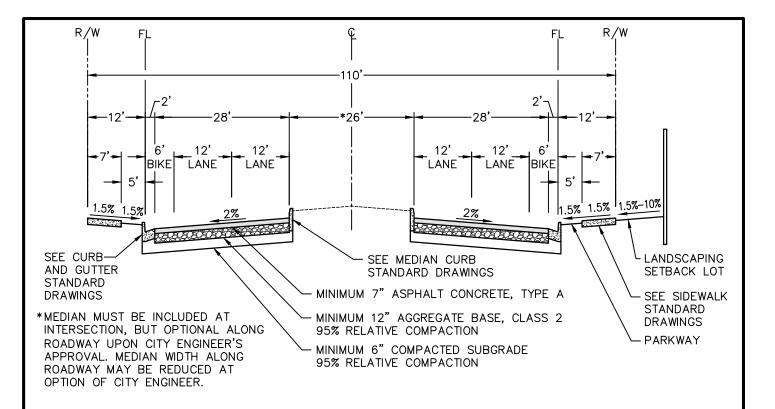

- 1. DESIGN CRITERION: TRAFFIC INDEX SHALL BE 11.
- 2. STRUCTURAL SECTIONS SHALL BE DETERMINED BASED ON T.I. AND R-VALUES AS TABULATED IN THE STREET SECTIONS REQUIREMENTS STANDARD DRAWING.
- 3. ASPHALT CONCRETE SHALL BE TYPE A, WITH 3/4" AGGREGATE GRADATION AND PG 64-10 LIQUID ASPHALT BINDER PER CITY OF VISALIA STANDARD SPECIFICATIONS.
- 4. TACK COAT IS REQUIRED AND SHALL BE APPLIED PER CITY STANDARD SPECIFICATIONS.
- 5. ASPHALT CONCRETE REQUIREMENTS SHALL BE AS STATED IN THE CITY OF VISALIA STANDARD SPECIFICATIONS.
- ASPHALT CONCRETE SHALL BE PLACED ONLY WHEN THE ATMOSPHERIC TEMPERATURE IS 50° F AND RISING.
- 7. WITH ADDITIONAL LANDSCAPE EASEMENTS, SIDEWALK MAY BE LOCATED OUTSIDE RIGHT OF WAY TO PROVIDE ADDITIONAL PARKWAY.
- 8. A FOOTING EASEMENT WILL BE REQUIRED AS NEEDED FOR BLOCK WALL FOOTINGS THAT EXTEND INTO PRIVATE PROPERTY.
- 9. STREET TREES ARE REQUIRED IN ADDITION TO THE ON-SITE LANDSCAPE REQUIREMENT.
- 10. FOR PARTIAL WIDTH STREETS A MINIMUM OF 30 FT OF PAVEMENT AND 8 FT SHOULDERS ARE REQUIRED.
- 11. MEDIAN BREAK LOCATIONS AND U-TURN MOVEMENT LOCATIONS ARE SUBJECT TO APPROVAL OF THE CITY ENGINEER.
- 12. UNIMPROVED MEDIAN SHALL BE LEFT WITH NATIVE SOILS 3" BELOW THE TOP OF CURB.
- 13. SOIL ADJACENT TO CONCRETE CURB AND SIDEWALK SHALL BE GRADED 3" BELOW TOP OF CURB TO ALLOW ROOM FOR MULCH.

APPROVED BY:


CITY OF VISALIA

DESIGN & IMPROVEMENT STANDARDS

REVISIONS

09/15/16
BK 2016

P-5

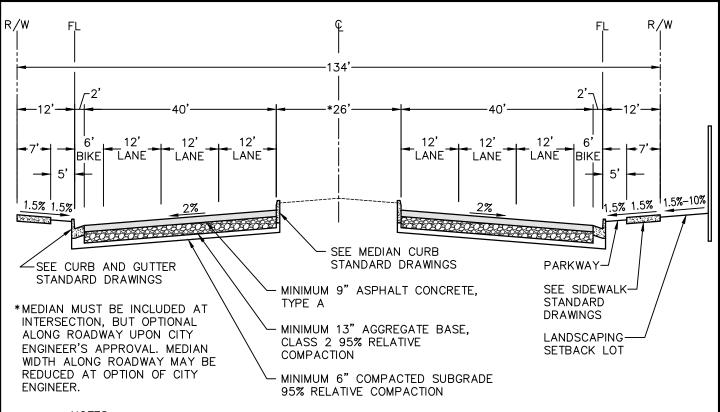

- 1. DESIGN CRITERION: TRAFFIC INDEX SHALL BE 13.
- 2. STRUCTURAL SECTIONS SHALL BE DETERMINED BASED ON T.I. AND R-VALUES AS TABULATED IN THE STREET SECTIONS REQUIREMENTS STANDARD DRAWING.
- 3. ASPHALT CONCRETE SHALL BE TYPE A, WITH 3/4" AGGREGATE GRADATION AND PG 64-10 LIQUID ASPHALT BINDER PER CITY OF VISALIA STANDARD SPECIFICATIONS.
- 4. TACK COAT IS REQUIRED AND SHALL BE APPLIED PER CITY STANDARD SPECIFICATIONS.
- ASPHALT CONCRETE REQUIREMENTS SHALL BE AS STATED IN THE CITY OF VISALIA STANDARD SPECIFICATIONS.
- 6. ASPHALT CONCRETE SHALL BE PLACED ONLY WHEN THE ATMOSPHERIC TEMPERATURE IS 50° F AND RISING.
- 7. WITH ADDITIONAL LANDSCAPE EASEMENTS, SIDEWALK MAY BE LOCATED OUTSIDE RIGHT OF WAY TO PROVIDE ADDITIONAL PARKWAY.
- 8. A FOOTING EASEMENT WILL BE REQUIRED AS NEEDED FOR BLOCK WALL FOOTINGS THAT EXTEND INTO PRIVATE PROPERTY.
- 9. STREET TREES ARE REQUIRED IN ADDITION TO THE ON-SITE LANDSCAPE REQUIREMENT.
- 10. FOR PARTIAL WIDTH STREETS A MINIMUM OF 30 FT OF PAVEMENT AND 8 FT SHOULDERS ARE REQUIRED.
- 11. MEDIAN BREAK LOCATIONS AND U-TURN MOVEMENT LOCATIONS ARE SUBJECT TO APPROVAL OF THE CITY ENGINEER.
- 12. UNIMPROVED MEDIAN SHALL BE LEFT WITH NATIVE SOILS 3" BELOW THE TOP OF CURB.
- 13. SOIL ADJACENT TO CONCRETE CURB AND SIDEWALK SHALL BE GRADED 3" BELOW TOP OF CURB TO ALLOW ROOM FOR MULCH.

APPROVED BY: 100 CITY OF VISALIA DESIGN & IMPROVEMENT STANDARDS

6 LANE ARTERIAL

CITY OF VISALIA DESIGN & IMPROVEMENT STANDARDS

REVISIONS


09/15/16
BK 2016


RESERVED FOR **FUTURE** DETAIL


CITY OF VISALIA APPROVED BY: DESIGN & IMPROVEMENT STANDARDS


RESERVED

REVISIONS 09/09/16

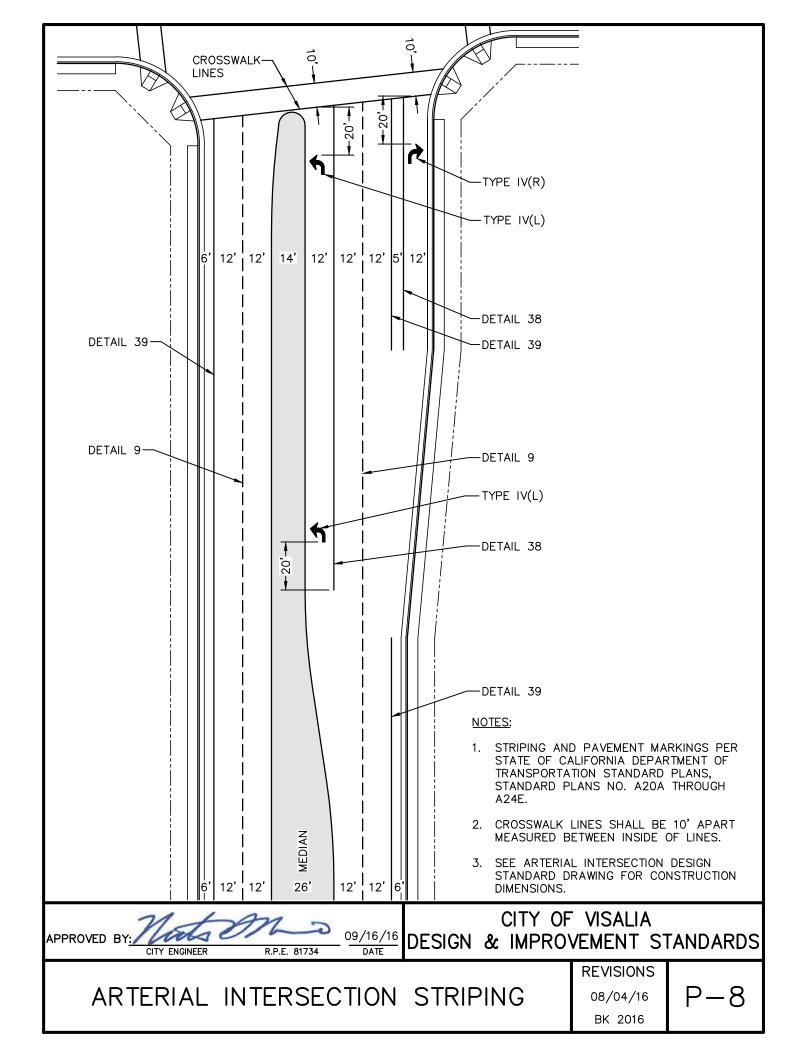

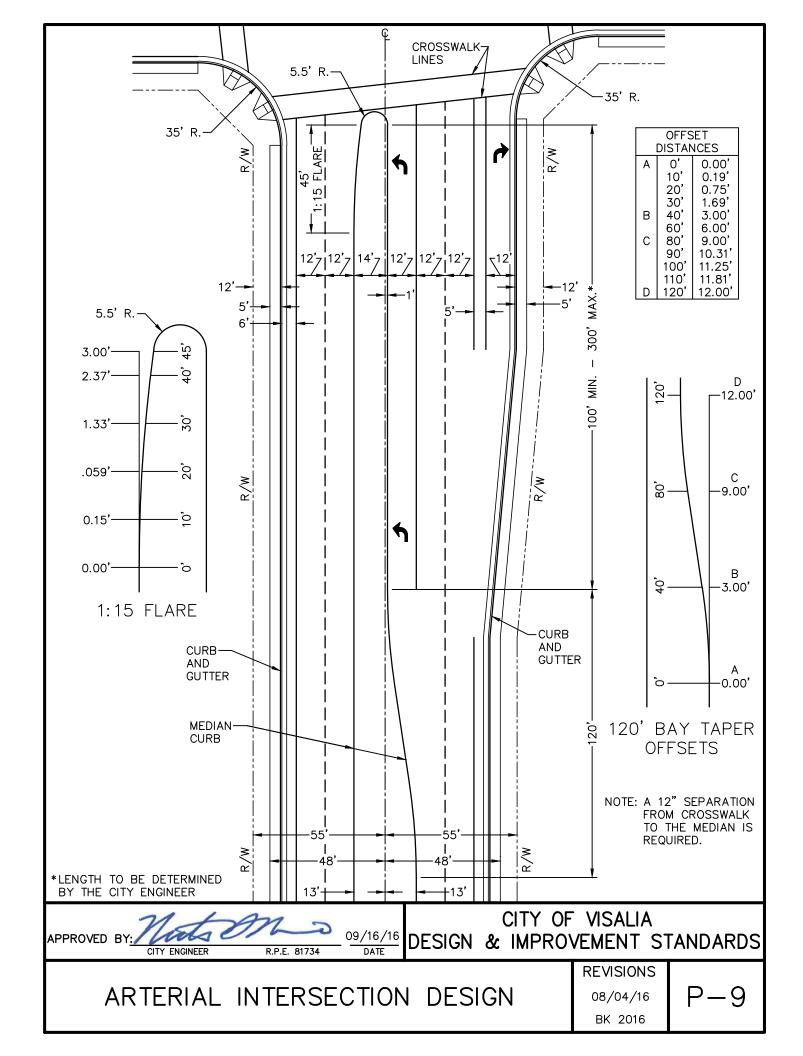


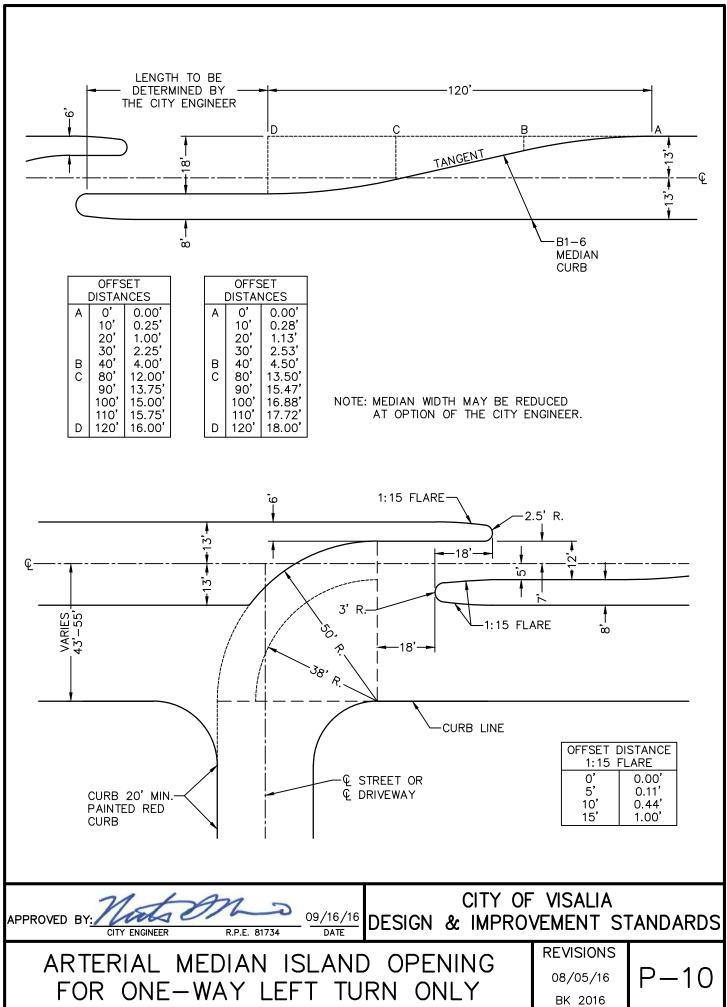


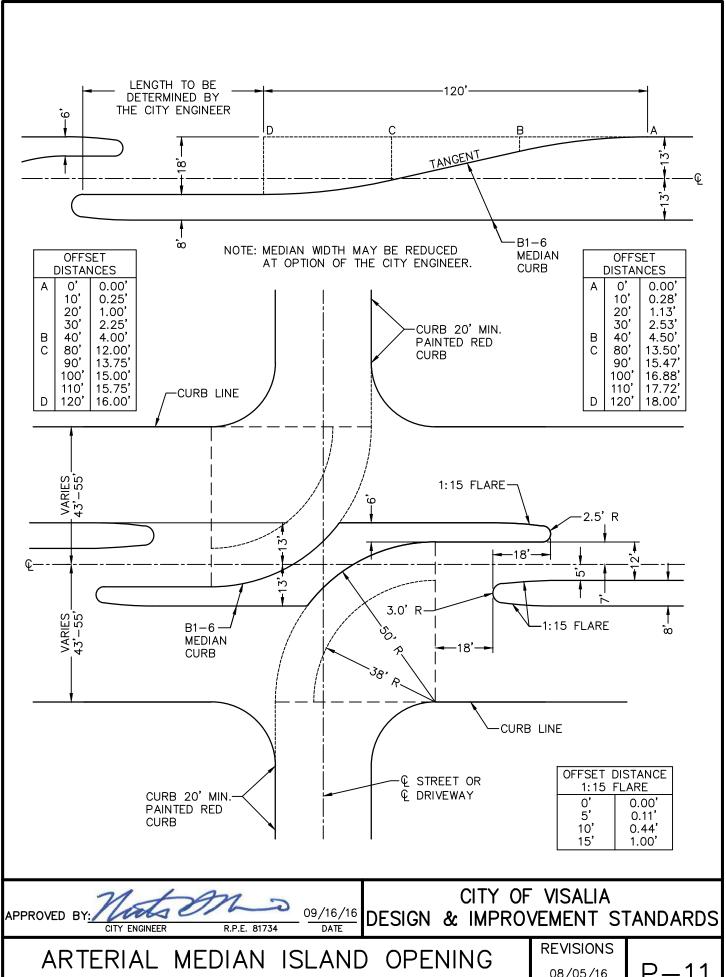


FOR TWO-WAY LEFT TURN ONLY

08/05/16

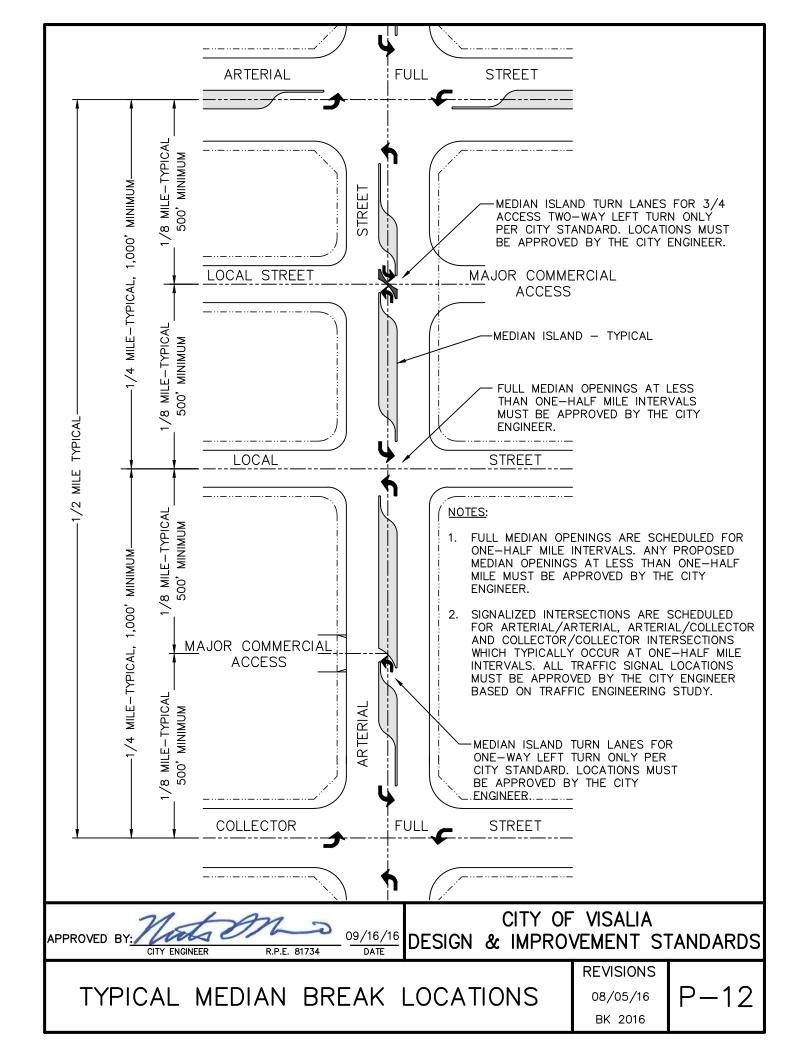

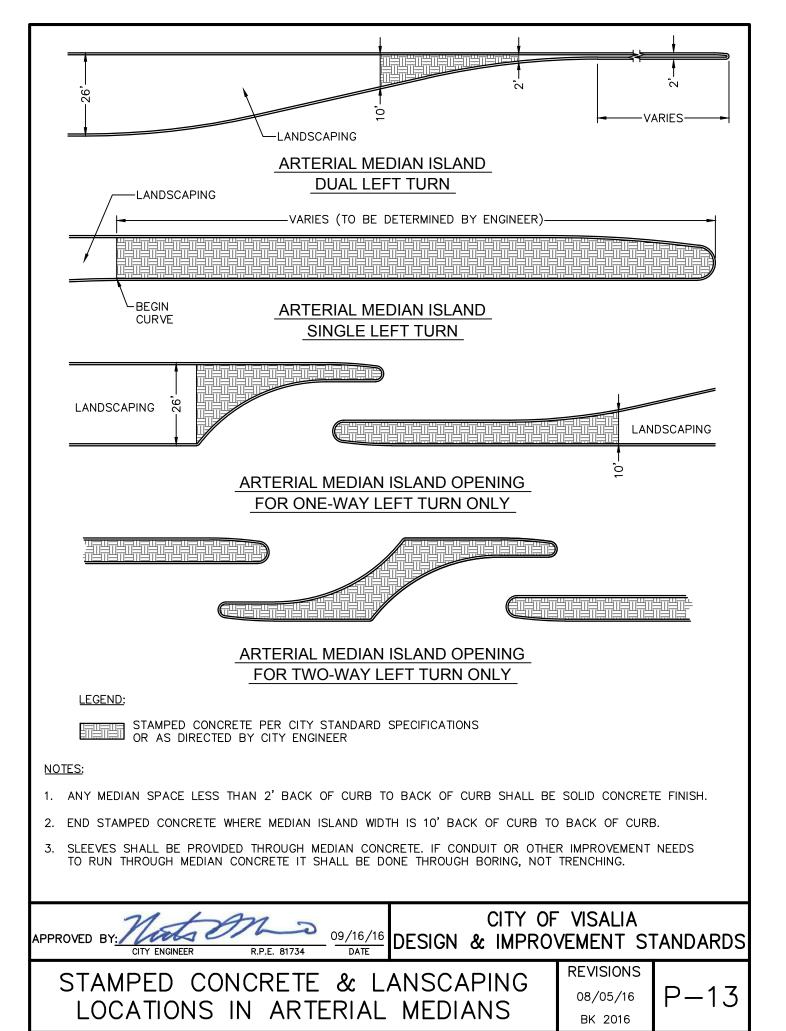

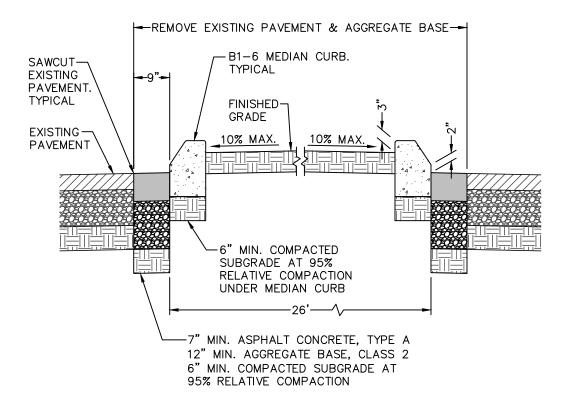

- 1. IF EXISTING PAVEMENT SECTION IS THICKER THAN SECTION THICKNESS MENTIONED ABOVE, THE PAVEMENT TO BE INSTALLED SHALL MATCH EXISTING.
- 2. IF MEDIAN WIDTH IS LESS THAN 6 FEET, THE MEDIAN SLOPE MAY BE INCREASED UP TO 25%.
- 3. MEDIAN IMPROVEMENTS, INCLUDING LANDSCAPING, SHALL NOT EXCEED 30" IN HEIGHT WITHIN THE SIGHT TRIANGLE AREA.
- 4. FULL DEPTH ASPHALT CONCRETE PLUG MAY BE ALLOWED WITH APPROVAL OF CITY ENGINEER.

APPROVED BY:

CITY OF VISALIA

O9/16/16
DESIGN & IMPROVEMENT STANDARDS


ARTERIAL MEDIAN INSTALLATION IN EXISTING PAVEMENT


REVISIONS


08/10/16


BK 2016

[>]−14

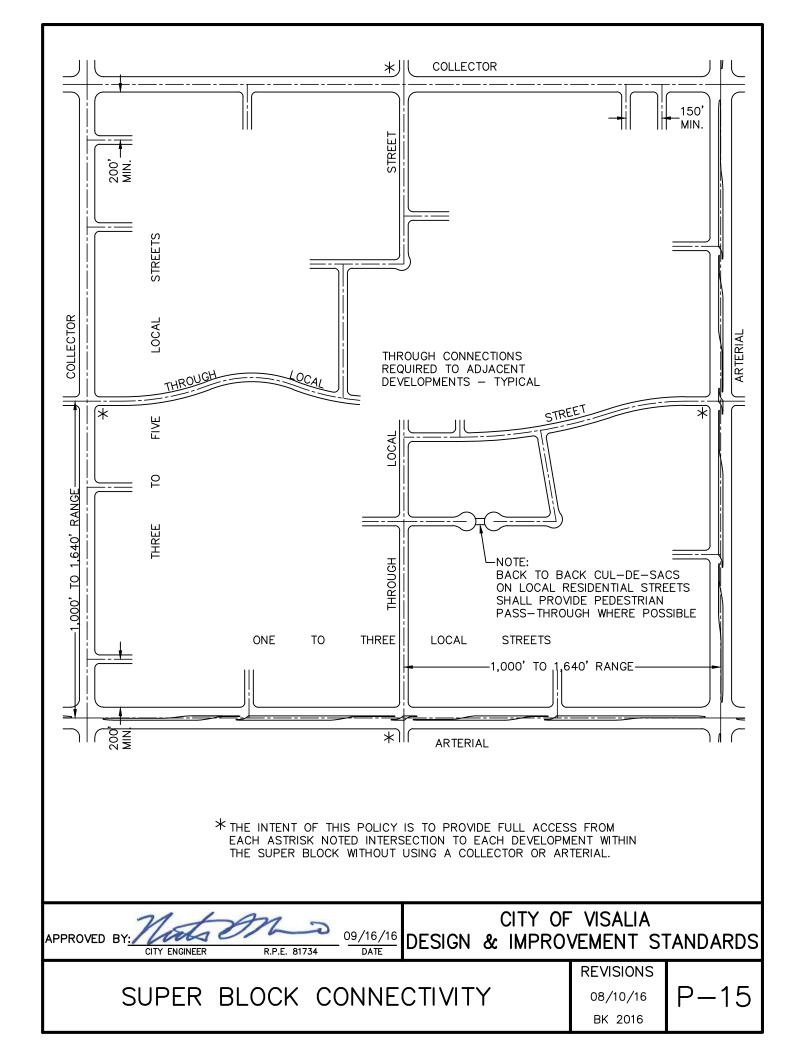

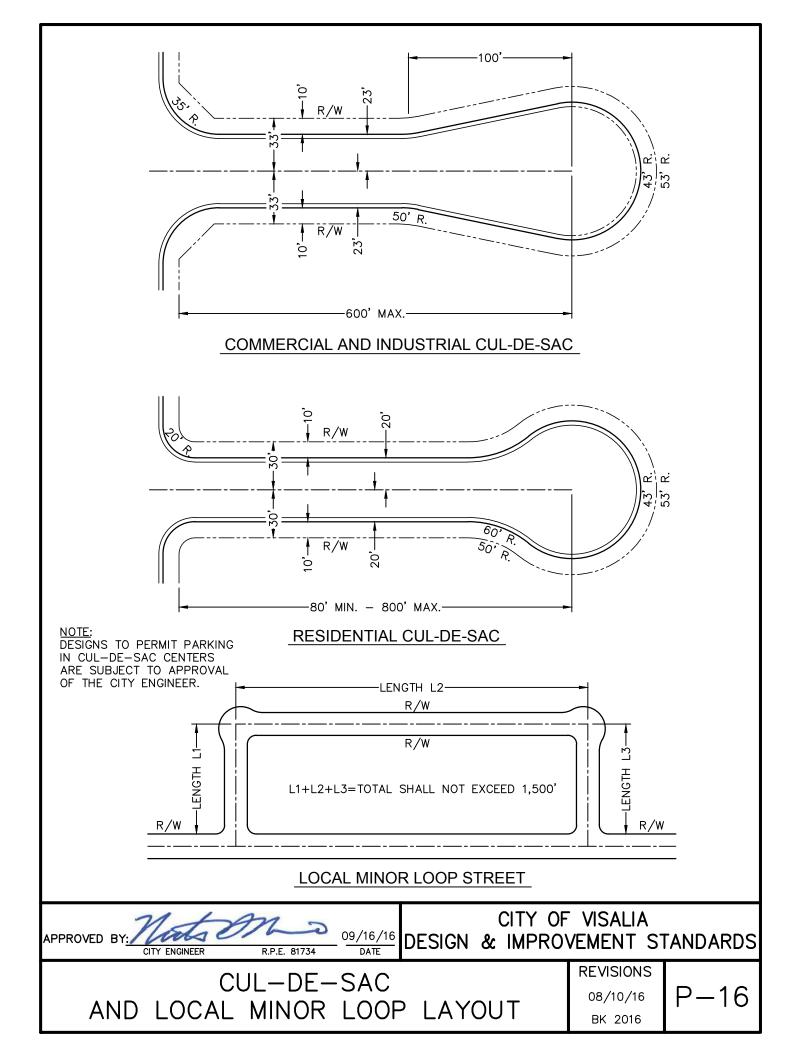


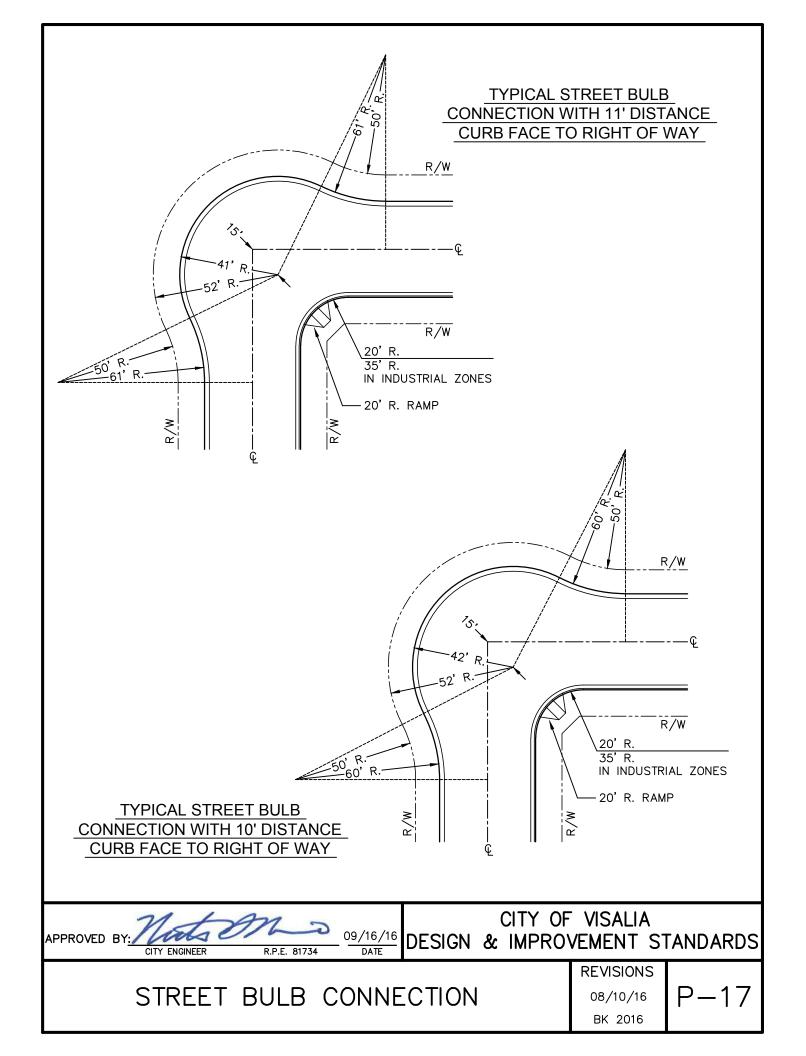

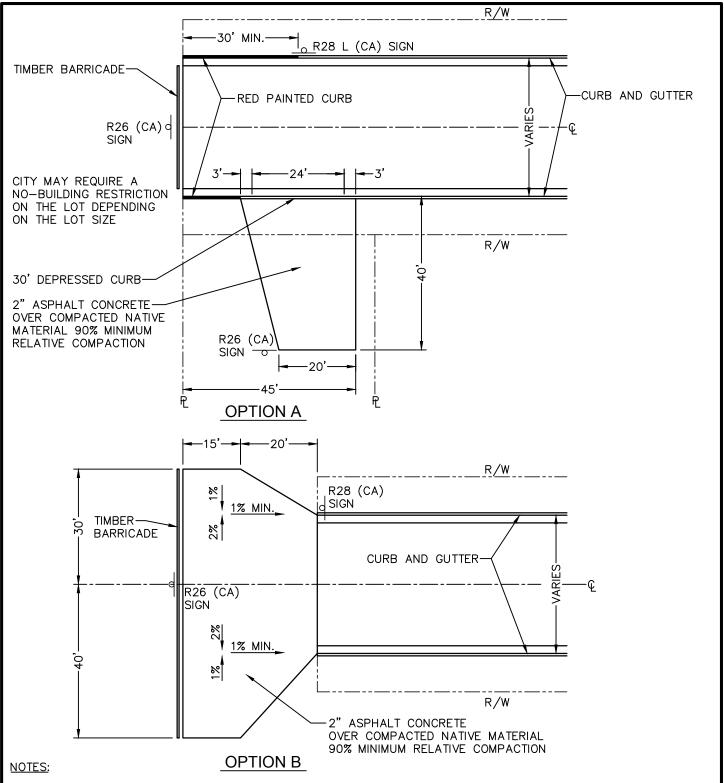

- THESE STANDARDS ARE INTENDED FOR PUBLIC STREETS IN PHASED DEVELOPMENTS ON A TEMPORARY BASIS ONLY.
- 2. TURNAROUND SHALL BE REQUIRED WHEN A STUB STREET IS IN EXCESS OF 2 LOTS OR IN EXCESS OF 150 FEET FROM THROUGH STREET.
- 3. USE OTHER THAN TEMPORARY SHALL BE AT THE DISCRETION OF THE CITY ENGINEER.



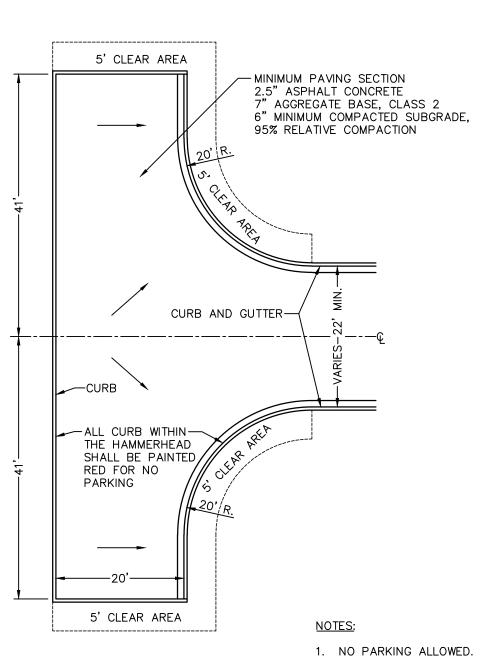

- 2. DESIGN CRITERION: TRAFFIC INDEX 5.5.
- 3. CURB OR CURB AND GUTTER REQUIRED AT ALL PAVEMENT EDGES.
- 4. NO ABOVE GROUND STRUCTURES SHALL BE ALLOWED IN THE 5' CLEAR AREAS AS SHOWN.
- 5. THE USE OF THIS STANDARD MUST BE APPROVED BY THE CITY OF VISALIA SOLID WASTE DIVISION.

APPROVED BY: CITY OF VISALIA

O9/16/16 DESIGN & IMPROVEMENT STANDARDS


PERMANENT HAMMERHEAD TURNAROUND

REVISIONS


08/10/16

BK 2016

P - 19

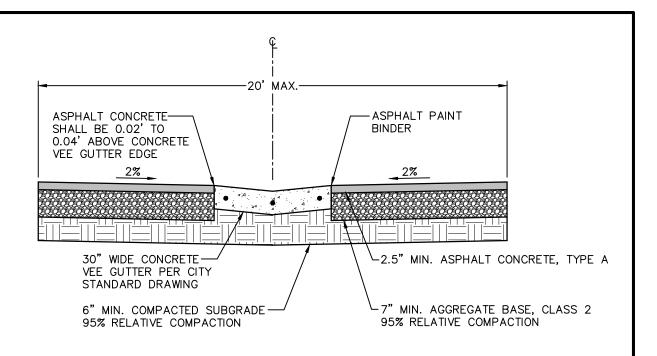

ASPHALT CONCRETE SURFACE

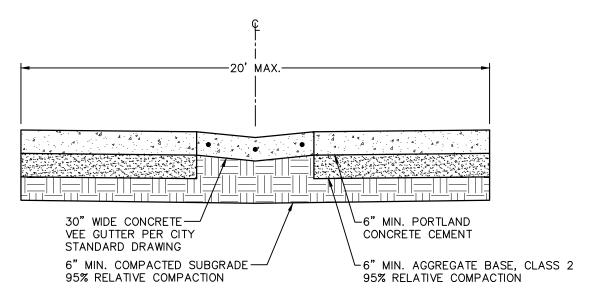

CONCRETE SURFACE

NOTES:

- 1. ALL CONCRETE SHALL BE CLASS 3 CONCRETE.
- 2. ALL CONCRETE SHALL HAVE A LIGHT BROOM FINISH.
- 3. DESIGN CRITERIA: TRAFFIC INDEX 5.5
- STRUCTURAL SECTIONS SHALL BE DETERMINED BASED ON T.I. AND R-VALUES AS TABULATED IN THE STREET SECTION REQUIREMENTS STANDARD DETAIL.

APPROVED BY: CITY ENGINEER R.P.E. 81734 O9/16/16 DESIGN & IMPROVEMENT STANDARDS

ALLEY PAVING SECTIONS

08/10/16

BK 2016

P - 20

PRIVATE STREET GUIDELINES

PAVEMENT WIDTHS:

- PRIVATE STREETS SHALL PROVIDE A PAVEMENT WIDTH COMMENSURATE WITH THE PROPOSED DESIGN SPEED. TRAFFIC VOLUME, ALIGNMENT AND PARKING REQUIREMENTS.
- A STREET PAVEMENT WIDTH OF 24', AND PARKING STALLS 20' IN LENGTH SHALL BE CONSIDERED MINIMUM IF THE PARKING STALLS ARE ORIENTED PERPENDICULAR TO THE STREET AND IF VEHICLES BACK INTO THE STREET TO EXIT. PARKING SPACES ORIENTED OTHERWISE SHALL CONFORM TO THE CITY OF VISALIA PARKING STANDARDS.
- 3. PRIVATE STREETS WITH ENTRY GATES SHALL PROVIDE A U-TURN AREA WITHIN THE PUBLIC RIGHT OF WAY. THE MINIMUM TURNING RADIUS SHALL BE 24'.
- STREET ENDS, COURTS OR DRIVEWAYS SHALL PROVIDE SOLID WASTE TRUCKS SERVICING INDIVIDUAL REFUSE CONTAINERS A MINIMUM OUTSIDE TURNING RADIUS OF 35' AND A MAXIMUM INSIDE TURNING RADIUS OF 20'. SOLID WASTE TRUCKS PROVIDING SERVICE TO REFUSE BINS REQUIRE A MINIMUM OUTSIDE TURNING RADIUS OF 50' AND A MAXIMUM INSIDE TURNING RADIUS OF 36'.
- 5. THE UNIFORM FIRE CODE REQUIRES THAT THE MOST REMOTE WALL OF ANY BUILDING MUST BE WITHIN 150' OF A PAVED DRIVE OR STREET NOT LESS THAN 20' WIDE. ACCESS TO BUILDINGS CONFORMING TO THIS REQUIREMENT SHALL PROVIDE A 14' MINIMUM PAVED ACCESS DRIVE AND A 20' MINIMUM UNOBSTRUCTED ACCESS EASEMENT. ACCESS TO BUILDINGS IN EXCESS OF TWO STORIES SHALL COMPLY TO MORE STRINGENT REQUIREMENTS OF THE FIRE CODE.

STRUCTURAL SECTIONS:

- THE STRUCTURAL SECTIONS OF STREETS UTILIZING ASPHALT CONCRETE SURFACING SHALL BE DESIGNED BY AN ACCEPTED FLEXIBLE PAVEMENT DESIGN METHOD.
- 2. THE MINIMUM STREET SECTION SHALL CONSIST OF A 2-1/2" TYPE A, 3/4" MAXIMUM, MEDIUM GRADE ASPHALT CONCRETE SURFACE, A 7" SECTION OF AGGREGATE BASE, CLASS 2, AND A 6" MINIMUM SOIL SUBGRADE COMPACTED TO A MINIMUM OF 95% RELATIVE COMPACTION.
- 3. PARKING AREAS AND ACCESS DRIVES MAY USE A PORTLAND CEMENT CONCRETE SURFACE A MINIMUM OF 6" THICK OVER A 6" AGGREGATE BASE OVER A 6" MINIMUM SOIL SUBGRADE COMPACTED TO A MINIMUM OF 90% RELATIVE COMPACTION.

TRAFFIC INDEXES:

THE CITY ENGINEER SHALL ESTABLISH TRAFFIC INDEXES FOR PRIVATE STREETS BASED UPON EXPECTED TRAFFIC VOLUMES AS INDICATED BELOW:

RESIDENTIAL UNITS USING STREET

MINIMUM TRAFFIC INDEX

APPROVED BY:/ CITY ENGINEER R.P.E. 81734

09/16/16

CITY OF VISALIA DESIGN & IMPROVEMENT STANDARDS

PRIVATE STREET GUIDELINES SHEET 1 OF 2

REVISIONS

08/10/16

PRIVATE STREET GUIDELINES CONTINUED

GEOMETRIC SECTIONS

- DRIVES SERVING 1 TO 4 UNITS SHALL USE A LOCAL ROAD PAVING SECTION STANDARD EXCEPTING THAT PAVEMENT EDGES SHALL BE PROTECTED WITH A 6" TALL CONCRETE CURB. SUBJECT TO SITE PLAN REVIEW, THE CURBING REQUIREMENT MAY BE WAIVED.
- 2. DRIVES OR STREETS SERVING 5 OR MORE UNITS SHALL PROVIDE A CURB OR CURB AND GUTTER AT ALL PAVEMENT EDGES.
- 3. PAVEMENT SHALL HAVE A MINIMUM CROSS SLOPE OF 1% AND PAVEMENT SECTIONS SHOULD MATCH THE EQUIVALENT LOCAL PUBLIC STREET.
- 4. BARRIER TYPE CURB AND GUTTER TYPE A2-6, IS RECOMMENDED FOR PRIVATE STREETS. THE FOLLOWING ARE PERMITTED OPTIONS.
 - A. VEE GUTTER, 24" MINIMUM WIDTH, SLOPE = 0.25 FEET PER 100 FEET MINIMUM.
 - B. MINI CURB AND GUTTER, 4" CURB HEIGHT AND 12" GUTTER, SLOPE = 0.20 FEET PER 100 FEET MINIMUM.
 - C. MINI ROLL CURB AND GUTTER, 4" CURB HEIGHT AND 12" GUTTER, SLOPE = 0.30 FEET PER 100 FEET MINIMUM.
- 5. FOR NEW ROADWAYS THAT ARE BEING CONSTRUCTED WHERE A PREVIOUS ROAD DID NOT EXIST, ALL ROADWAY INFRASTRUCTURE SHALL BE INSTALLED & OPERATIONAL PRIOR TO OPENING. THIS INCLUDES SIGNAGE, STRIPING, AND ROADWAY LIGHTING.

REQUIRED SIGNS:

 THE ENTRANCE TO ANY PRIVATE STREET FROM A PUBLIC RIGHT OF WAY SHALL HAVE A SIGN "PRIVATE STREET" POSTED AT THE ENTRANCE.

APPROVED BY: Male Provided BY: CITY ENGINEER R.P.E. 81734

09/16/16 DATE

CITY OF VISALIA
DESIGN & IMPROVEMENT STANDARDS


PRIVATE STREET GUIDELINES SHEET 2 OF 2


REVISIONS

08/10/16

BK 2016

P-22

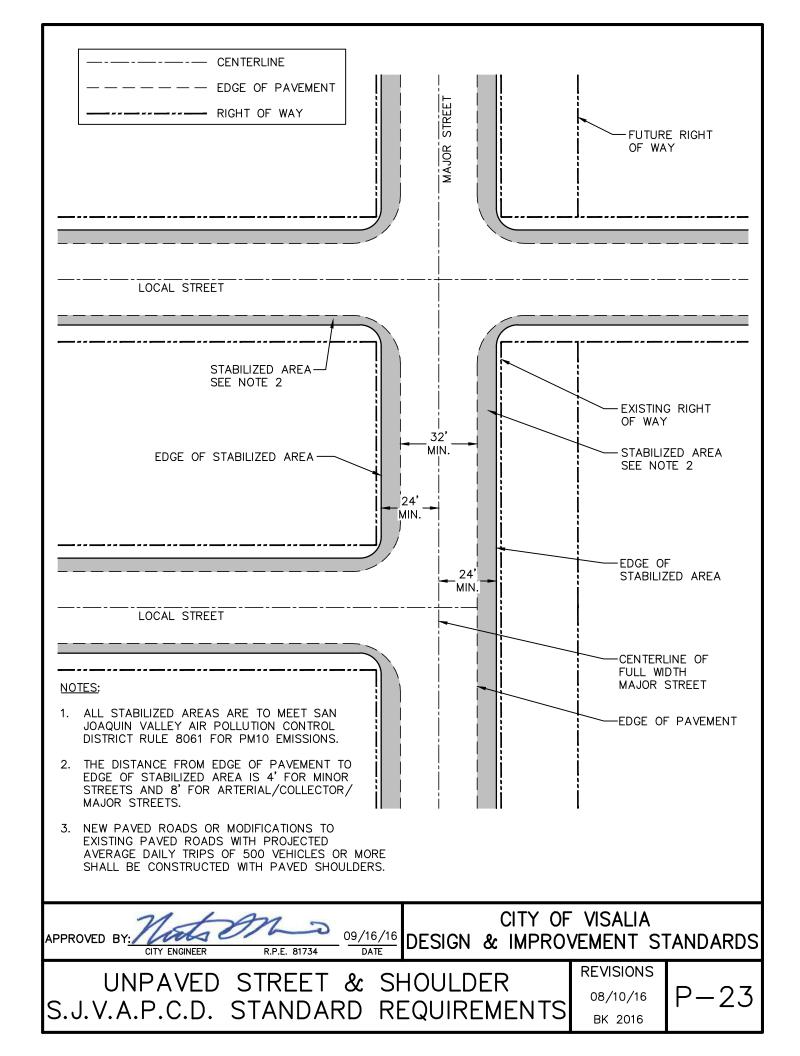

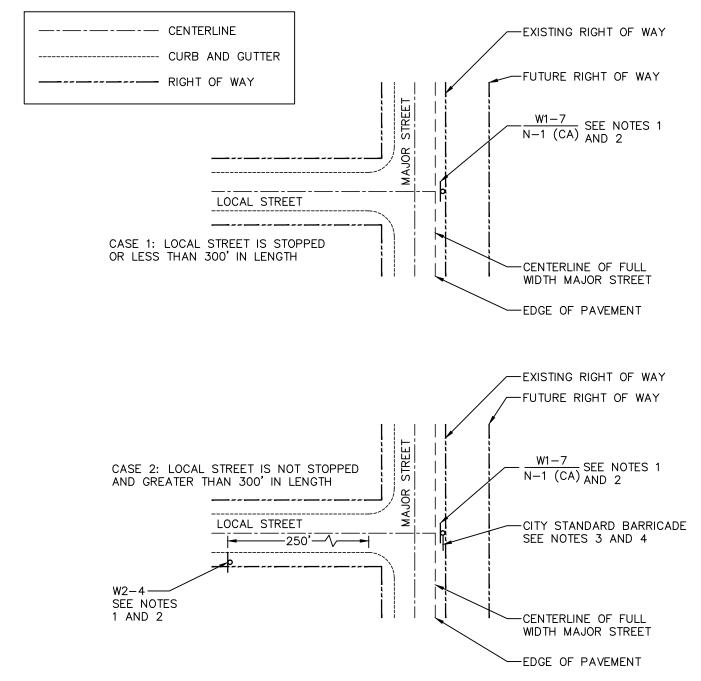

- 1. ALL SIGNS ARE TO MEET CITY STANDARDS FOR RETROREFLECTIVITY, FACE SHEETING, SIGN GAUGE, POST TYPE, AND ANCHORING/FOOTING PROCEDURES.
- 2. SIGNS ARE TO BE INSTALLED A MINIMUM OF 4' BACK FROM EDGE OF PAVEMENT.
- 3. CITY STANDARD BARRICADE IS TO BE INSTALLED IF OBJECTS IN THE PATH OF ONCOMING TRAFFIC MAY FORM A HAZARD (I.E. ORCHARD, TREE STAND, EARTHWORK, BUILDING, ETC.).
- 4. IF REQUIRED, CITY STANDARD BARRICADE IS TO BE INSTALLED BETWEEN 4' AND 8' BACK FROM EDGE OF PAVEMENT, DEPENDENT ON SURROUNDING AREA.
- 5. ALL SIGNS ARE TO MEET THE LATEST CALIFORNIA MUTCD GUIDELINES.



								<u> </u>					<u> </u>							_
	3	AB	30,	29"	28"	27"	26"	25"	24"	24"	23"	22"	21"	20,	19"	18"	17"	16"	15"	17,
		НМА	8.5"	8.5"	8.5"	8.5"	8.5"	8.5	8.5"	8.5"	8.5"	8.5"	8.5"	8.5"	8.5"	8.5"	8.5"	8.5"	8.5"	α π
	2	AB	26"	25"	24"	23"	23"	22"	21"	20"	19"	19"	18"	17"	16"	15"	15"	14"	13"	10"
	12	НМА	.8	.8	 %	8	w		w	.8	8	w	w	.8	.8	.8	 %	.8		å
	_	AB	24"	23"	23"	22"	21"	20"	19"	19"	18"	17"	16"	16"	15"	14"	13"	13"	12"	10,
Ç	1	НМА	7"	7"	7"	7"	7"	7"	7"	7"	7"	7"	7"	7"	7"	7"	7"	7"	7"	1,1
	0	AB	22"	21"	21"	20,	19"	19"	18"	17"	16"	16"	15"	14"	14"	13"	12"	12"	11"	11,
	1	HMA	.9	.9	.9	.9	.9	.9	.9	.9	.9	.9	.9	.9	.9	.9	.9	.9	.9	"
		AB	19"	19"	18"	17"	17"	16"	15"	15"	14"	14"	13"	12"	12"	11"	10"	10"	10"	,,,
E	၈	НМА	5.5"	5.5"	5.5"	5.5"	5.5"	5.5"	5.5"	5.5"	5.5"	5.5"	5.5"	5.5"	5.5"	5.5"	5.5"	5.5"	5.5"	""
INDEX	8	AB	16"	16"	15"	15"	14"	14"	13"	12"	12"	11,	11,	10"	10,,	.6	.6			ŗ
		НМА	2,	2,	2,	2,	2,	2,	2,	2,	2,	2,	2,	2,	2,,	2,,	2,	2,	2,	
	7.5	AB	16"	15"	15"	14"	14"	13"	13"	12"	12"	11,	11,	10"	6,,	.6	ω,		ω,	.0
		НМА	4.5"	4.5"	4.5"	4.5"	4.5"	4.5"	4.5"	4.5"	4.5"	4.5"	4.5"	4.5"	4.5"	4.5"	4.5"	4.5"	4.5"	" "
	7	AB	15"	14"	14"	13"	13"	12"	12"	11"	11"	10,	10,	6,,	6,,	8	"	.8	, %	î
		HMA	4,,	4,,	.4	.,4	.4	.4	.4	4,,	.,4	.4	.4	4,,	4,,	4,,	.,4	4,,	.4	.,
	6.5	AB	15"	15"	14"	14"	13"	13"	12"	12"	11,	11,	10,	10,,	10,,	.6	.6	" %	"ω	0
		HMA	3,,	3"	3,,	3,,	3,,	3,	3,,	3"	3,,	3,,	3,	3"	3"	3,,	3,,	3,,	3,,	"~
	9	AB	14"	14"	13"	13"	12"	12"	11,	11"	11,	10,	10,	.6	6,,	.6	, w	7,,	7"	1,1
		НМА	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	" "
		AB	12"	12"	12"	11"	11,	1,	10,	10,	.6	" 6	" 6		.8	7"	7"	1,	1,	1,,
	5.5	НМА	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	2.5"	" "
R-VALUE OF SUBGRADE			10	12	14	16	18	20	22	24	76	28	30	32	34	36	38	40	42	,

- ALL AB AND HMA SHALL CONFORM WITH THE CITY OF VISALIA AB = CLASS 2 AGGREGATE BASE. HMA = HOT MIX ASPHALT. ENGINEERING STANDARD SPECIFICATIONS.
- 2. TRAFFIC INDEXES USED SHALL BE AS APPROVED BY THE CITY ENGINEER.
- A CALIFORNIA R-VALUE REPORT SHALL BE SUBMITTED TO THE CITY ENGINEERING DEPARTMENT FOR REVIEW AND ACCEPTANCE. THIS REPORT SHALL BE STAMPED AND SIGNED BY A REGISTERED CIVIL ENGINEER FROM A CERTIFIED TESTING LABORATORY. THE REPORT SHALL INCLUDE THE TEST RESULTS, DATA SHEETS, AND SOIL CLASSIFICATION OF ALL R-VALUE TESTS AND A MAP THAT SHOWS THE LOCATION OF ALL TESTS TAKEN AND THE R-VALUES ON THE SITE. IN GENERAL R-VALUE TESTING SHALL BE PERFORMED AT 300' INTERVALS IN A ROADWAY UNLESS APPROVED OTHERWISE BY THE CITY ENGINEER. ь.
- WHERE SUBGRADE R-VALUES ARE LESS THAN 30 A MODIFIED STREET SECTION MAY BE PROPOSED. ALL MODIFIED STREET SECTIONS MUST BE ACCOMPANIED BY A LETTER OF APPROVAL STAMPED AND SIGNED BY A REGISTERED CIVIL ENGINEER FROM A CERTIFIED TESTING LABORATORY. PROPOSALS SHALL BE REVIEWED BY THE CITY ENGINEER. THE CITY IS UNDER NO OBLIGATION TO ACCEPT ANY MODIFIED STREET SECTION PROPOSALS. 4.
- STREET SECTION REQUIREMENTS SHOWN ON THIS DETAIL SUPERCEDE STREET SECTIONS SHOWN ON ALL OTHER PAVEMENT SECTION DETAILS. S.

APPROVED BY: Note that the second of the sec

STREET SECTION REQUIREMENTS

REVISIONS 08/11/16